



TYPICAL SYSTEM CONFIGURATION

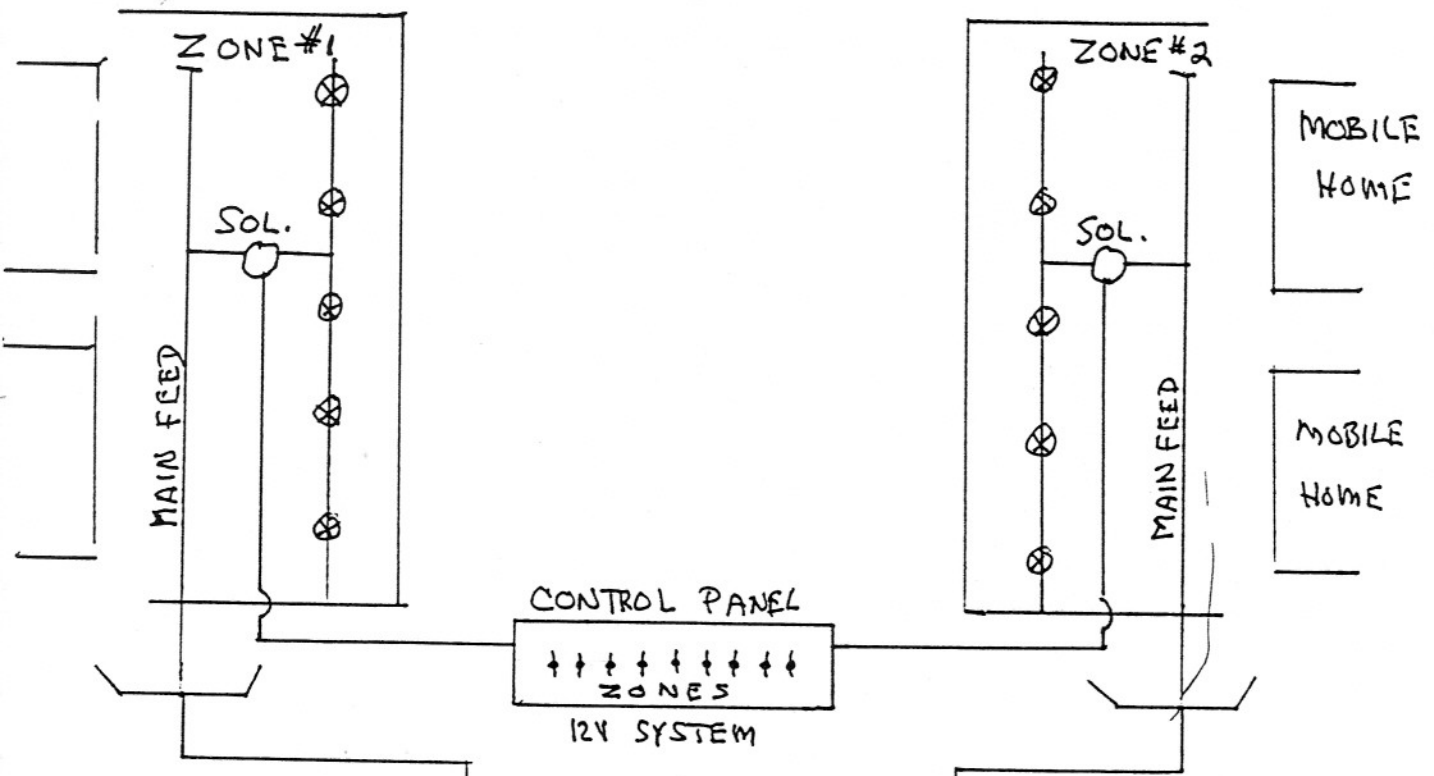

TO ALL MAIN FEEDS

Piped Underground to
To All Zones In System

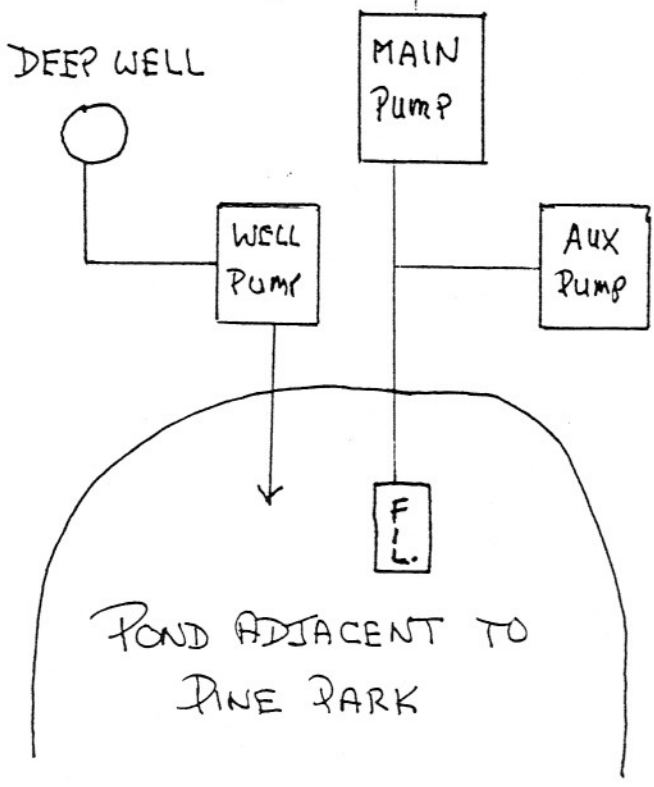

- Activation Steps
1. Turn on pump, water fills all main feeds.
 2. Turn on desired zone at control panel. Solenoid in zone allows flow of water from main feed to sprinkler heads.
 3. Auxiliary pump used when main pump fails.
 4. Well pump used to fill pond from from deep well.